

PAD MOUNT

NOTES

-4" slipfitter

← 4" steel pipe

X 5" handhole with cover

 $_{-}$ #4 bars at approximately 1 $^{\prime}$ -0 $^{\prime\prime}$ centers

-5/8'' X 2'-0'' X 4'' steel anchor bolts

7;

 \circ

,,0-


, M $\overset{'}{\sim}$

2'-0''

(square or round)

PEDESTAL MOUNT

- 1. Where pad or pedestal mounts are located in a sidewalk, construct mount top flush with sidewalk grade, omitting chamfer where top and sidewalk abut.
- 2. Pad mount design is typical.
- 3. Place a silicone seal between the cabinet foundation and the cabinet for the pad mount design.

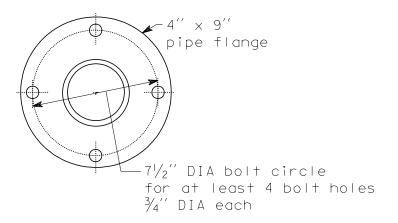

PEDESTAL BASE DETAILS



CABINET FOUNDATION DETAILS

STANDARD PLAN J-6c

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATI THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION, IS KEPT ON FILE AT THE WASHINGTON STATE DEPARTMENT OF TRANSPORTATION. A COPY MAY BE OBTAINED UPON REQUEST. APPROVED FOR PUBLICATION

Clifford E. Mansfield

DEPUTY STATE DESIGN ENGINEER

WASHINGTON STATE DEPARTMENT OF TRANSPORTATION OLYMPIA, WASHINGTON

4/24/98